


ELECTRICAL BASEMENT FLOOR DEMOLITION PLAN
SCALE: 1/4" = 1'-0"

- GENERAL NOTES - ELECTRICAL DEMOLITION**
1. SITE CLEAR ALL CONDUIT, WIRE AND NM CABLE DISCOVERED ABANDONED, OR LEFT ABANDONED AT THE END OF THE PROJECT.
 2. ALL FIXTURES SHOWN ARE TO BE SITE CLEARED, UNLESS NOTED OTHERWISE. COORDINATE WITH THE OWNER FOR FIRST RIGHT OF REFUSAL OF REMOVED FIXTURES.
 3. CONTRACTOR SHALL EVALUATE EXISTING CIRCUITS TO DETERMINE THEIR ROUTING AND LOADING. RE-FEED ALL EQUIPMENT THAT IS EXISTING TO REMAIN OR TO BE REUSED.
 4. COORDINATE WITH OTHER TRADES AND INCLUDE WORK REQUIRED BY THOSE TRADES TO COMPLETE THE DEMOLITION.
 5. SITE CLEAR ALL REMOVED LIGHT FIXTURES MOUNTED IN AND ON THE BUILDING. UNLESS NOTED OTHERWISE. UTILIZATION OF EXISTING CONDUIT SYSTEMS IS ACCEPTABLE WHERE THE CONTRACTOR DEEMS IT ADVANTAGEOUS.
 6. SOME ELECTRICAL EQUIPMENT TO BE REMOVED IS NOT SHOWN ON THIS PLAN. IT IS THE INTENT OF THIS PLAN TO SUPPLEMENT THE REQUIREMENTS OF THE GENERAL CONTRACTOR AND THE ELECTRICAL CONTRACTOR'S FIELD VERIFICATION OF EQUIPMENT. IT IS THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR TO REMOVE ALL ELECTRICAL EQUIPMENT AS REQUIRED TO PROVIDE THE NEW INSTALLATIONS AS SHOWN ON THESE DRAWINGS. NO ELECTRICAL EQUIPMENT IS TO REMAIN ON SITE WHICH IS NOT SUITABLY POWERED AND CONTROLLED.

- PLAN NOTES - SHEET E100**
- 1 DISCONNECT AND REMOVE NOTED RECEPTACLE AND SALVAGE CIRCUIT FOR REUSE WITH NEW OUTLET IN BASEMENT ADDITION.
 - 2 DISCONNECT AND REMOVE EXISTING CT AND METER CABINET. COORDINATE WITH UTILITY COMPANY.
 - 3 DISCONNECT AND RELOCATE EXISTING CONDENSING UNITS TO NEW LOCATION. COORDINATE LOCATION WITH HVAC DRAWINGS. LOCATION SHOWN IS APPROXIMATE.
 - 4 DISCONNECT AND REMOVE NOTED RECEPTACLE. RECONNECT DEVICES THAT ARE TO REMAIN.
 - 5 DISCONNECT AND REMOVE NOTED RECEPTACLE. SALVAGE CIRCUIT FOR REUSE WITH NEW EXTERIOR RECEPTACLE.
 - 6 DISCONNECT AND RELOCATE EXISTING CATV ENTRANCE EQUIPMENT. COORDINATE WITH LOCAL UTILITY COMPANY.
 - 7 DISCONNECT AND REMOVE EXISTING SIGN LIGHT. SITE CLEAR CIRCUIT TO NEAREST SPLICE POINT OR ORIGIN.
 - 8 DISCONNECT AND REMOVE EXISTING SPEAKERS. SALVAGE CABLING FOR REUSE.
 - 9 DISCONNECT AND REMOVE EXISTING SURFACE WRAPAROUND AND TURN OVER TO OWNER. DISPOSE OF ANY FIXTURES THE OWNER DOES NOT WANT TO SALVAGE.
 - 10 DISCONNECT AND REMOVE EXISTING DOWNLIGHT. SITE CLEAR CIRCUIT TO NEAREST SPLICE POINT OR ORIGIN.
 - 11 SITE CLEAR MISCELLANEOUS ELECTRICAL FOUND IN WALLS SCHEDULED FOR DEMOLITION. RECONNECT EXISTING DEVICES AND SYSTEMS THAT ARE TO REMAIN.
 - 12 DISCONNECT AND REMOVE NOTED RECEPTACLE AND REPLACE WITH A NEW TAMPER RESISTANT RECEPTACLE.
 - 13 DISCONNECT AND REMOVE EXISTING MAIN ELECTRICAL PANEL. INSTALL NEW PANEL IN SAME LOCATION AS EXISTING. COORDINATE SERVICE OUTAGE WITH THE OWNER AND UTILITY COMPANY.

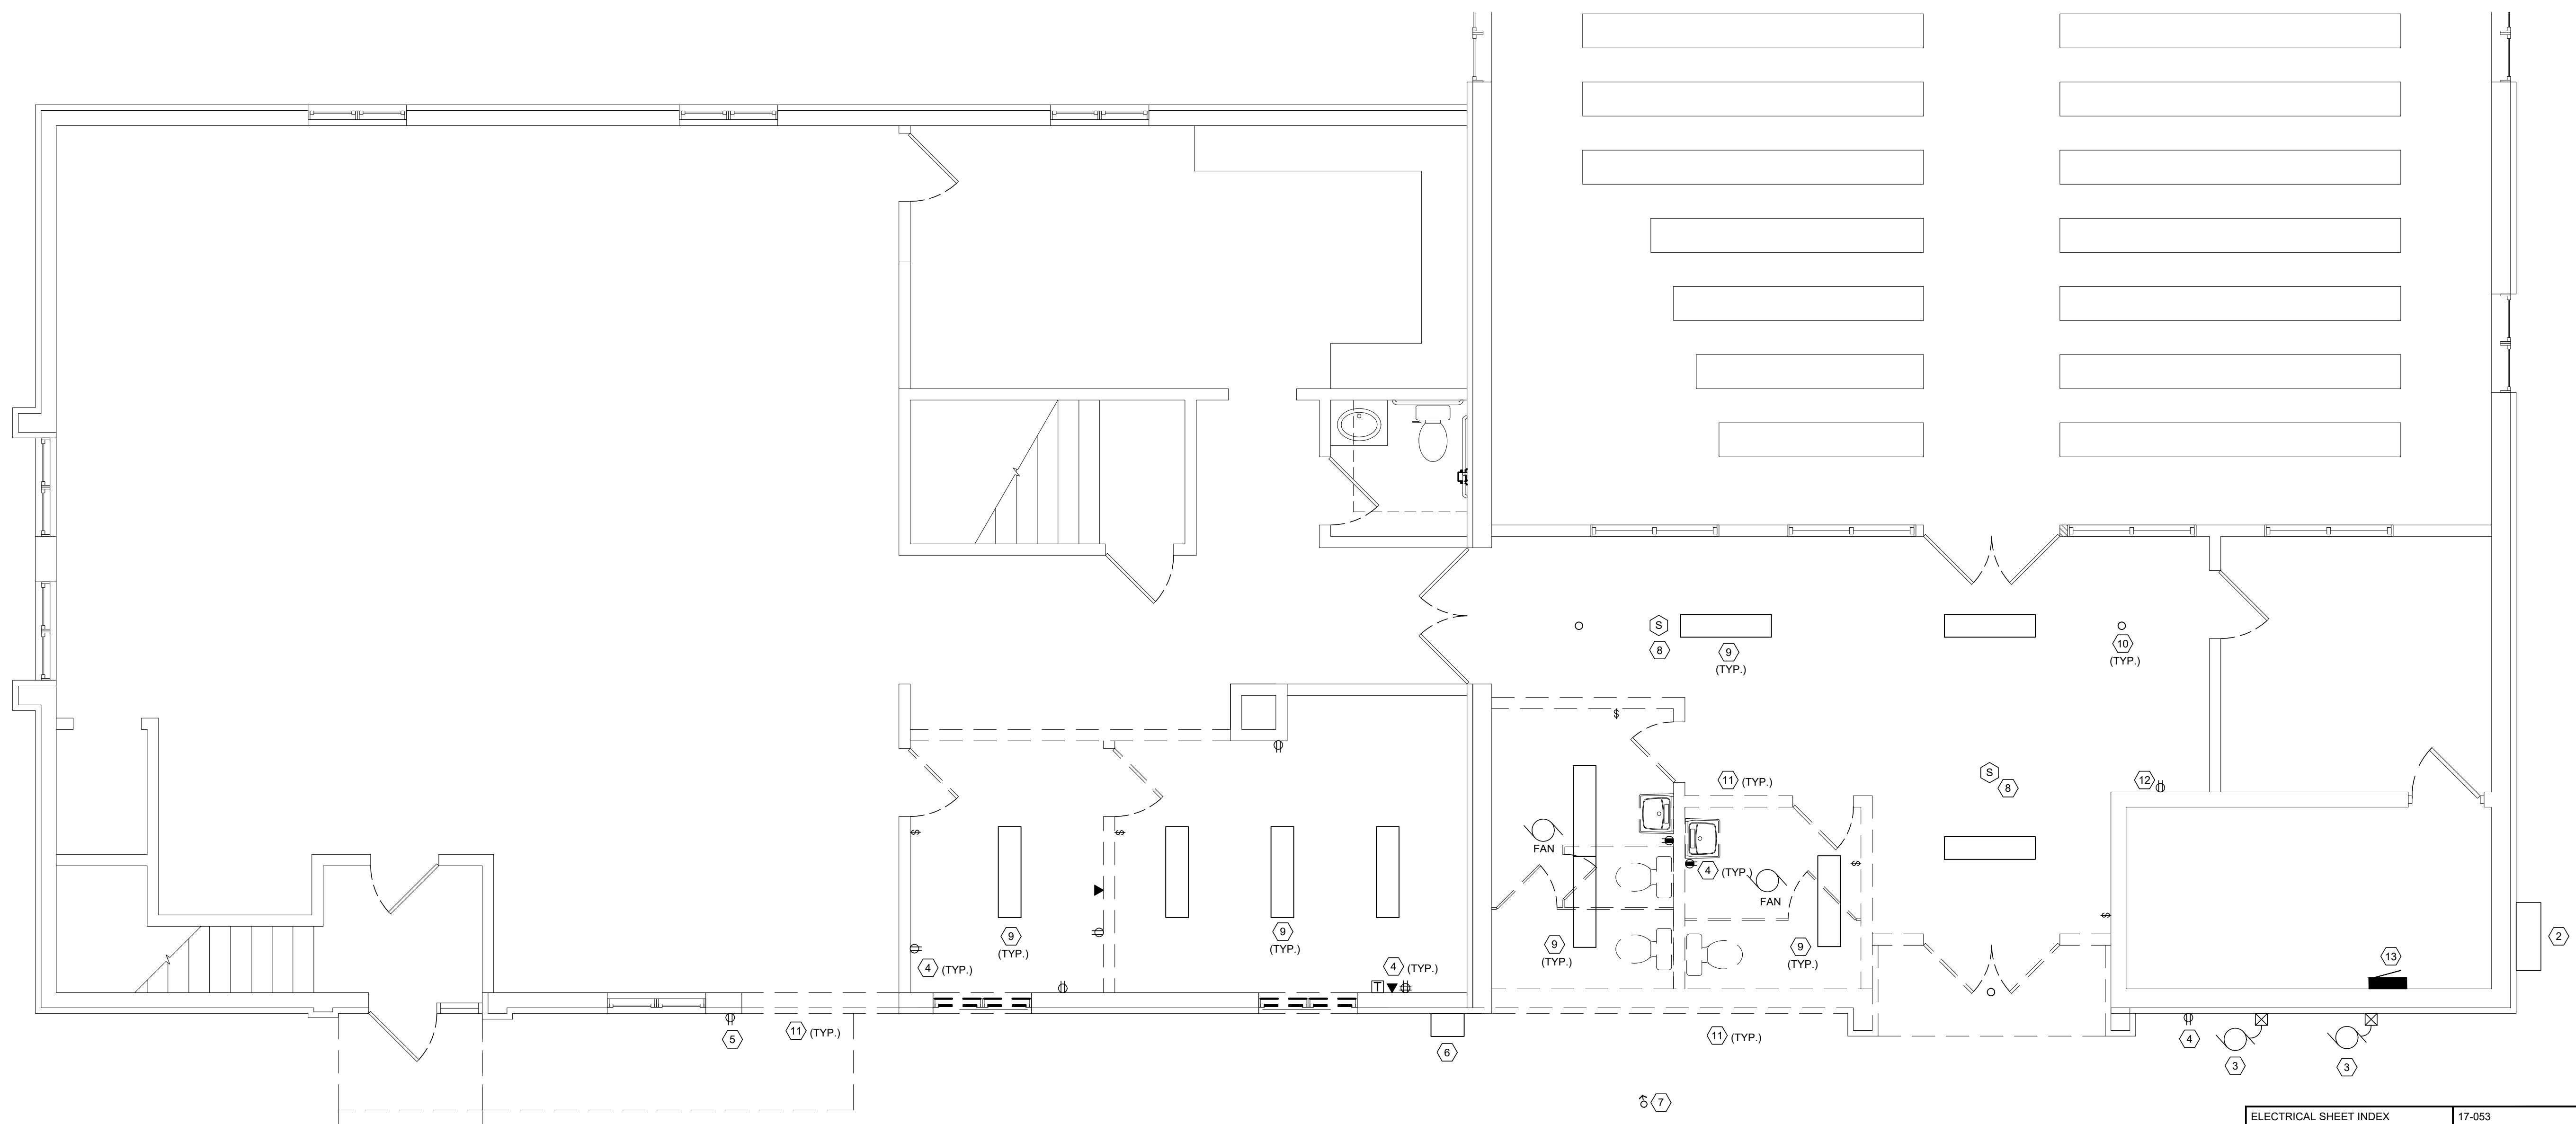

ELECTRICAL MAIN FLOOR DEMOLITION PLAN
SCALE: 1/4" = 1'-0"

ELECTRICAL SHEET INDEX		17-053
E100	ELECTRICAL - DEMOLITION PLAN	
E200	ELECTRICAL - LIGHTING PLAN	
E201	ELECTRICAL - EMERGENCY LIGHTING PLAN	
E202	ELECTRICAL - POWER/SYSTEMS PLAN	
E700	ELECTRICAL - SCHEDULES AND DETAILS	
E701	ELECTRICAL - RISER AND SYMBOLS PLAN	

MIDWEST DESIGN SOLUTIONS, LLC
2676 Bay Settlement Rd
Green Bay, WI 54311
harland@mwsdesign.com
(920) 471-0805

DIMENSION IV
Planning, Architecture Design, and Construction Administration
Green Architecture and Sustainable Design
211 N. Broadway
Suite 204
Green Bay, WI 54303
Phone (920) 431-3444
Fax (920) 431-3445
www.dimensioniv.com

**MT OLIVE CHURCH
ADDITION/REMODELING**

2460 Mt Olive Dr.

Verify all existing site conditions
REVISIONS:

SHEET INDEX:	
ELECTRICAL DEMOLITION PLAN	

Copyright © 2017
Ideo House, Inc.
DRAWN: HLM APPRVD: HLM
May 2, 2017

E100
17-053 E100.DWG